




## WIRING SPECIFICATION FOR ELECTRONIC SCOREBOARDS/SHOT CLOCKS

TO BE PROVIDED BY THE CUSTOMER OR HIS CONTRACTOR

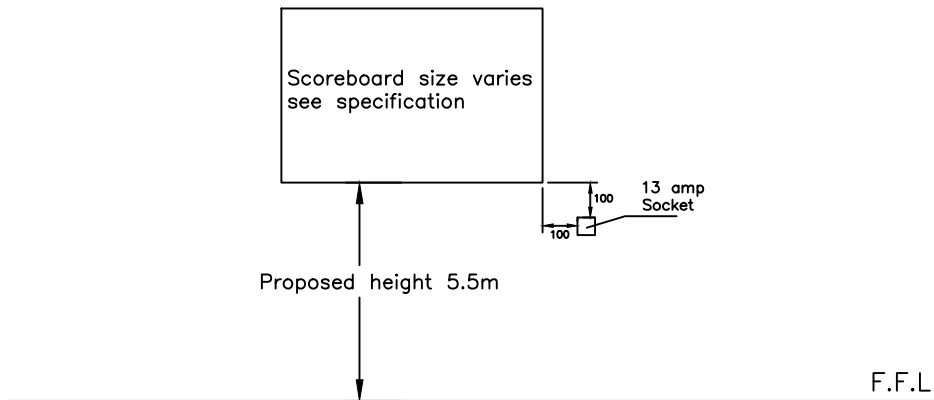

### Scoreboards

A 220/250V a/c supply unswitched 13 amp socket to be installed at high level adjacent to scoreboard location at the bottom right hand corner. A remote switch should be fitted at low level.

### Shot clocks – backboard mounted

A 220/250V a/c supply unswitched 13 amp socket to be installed at high level above each shot clock located adjacent to the front left drop leg. A remote switch should be fitted at low level.

### Shot clocks – wall mounted

A 220/250V a/c supply unswitched 13 amp socket to be installed at high level adjacent to each shot clock location at the bottom right hand corner. A remote switch should be fitted at low level.

The installation should be carried out in accordance with current I.E.E Regulations.

Transmit frequency 869.2–870.0 MHz

TITLE WIRING SPECIFICATION FOR ELECTRONIC  
SCOREBOARDS & SHOT CLOCKS

INFO SHEET No.

7351

DATE

12.05.2015

ISSUE


H

DRAWN

PS

SCALE

N.T.S

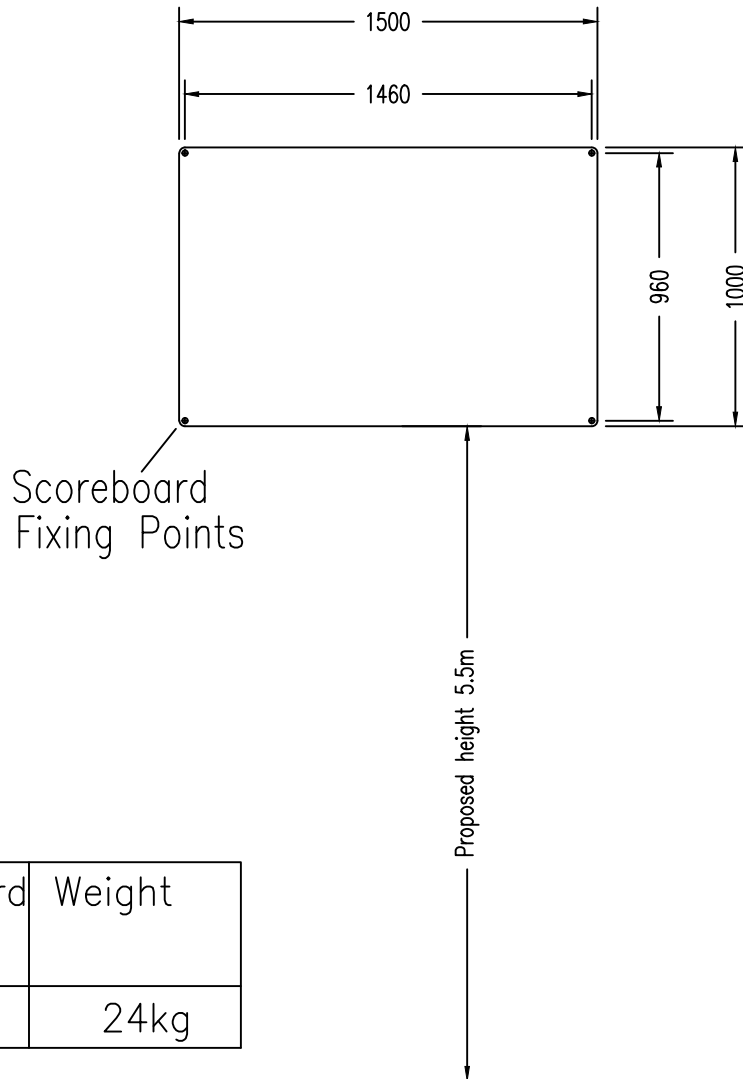

| Scoreboard | Weight |
|------------|--------|
| MS3000     | 24kg   |

TITLE 452 MS3000 SCOREBOARD

INFO SHEET No. 7354

DATE 12.05.2015 ISSUE A DRAWN PS SCALE N.T.S